

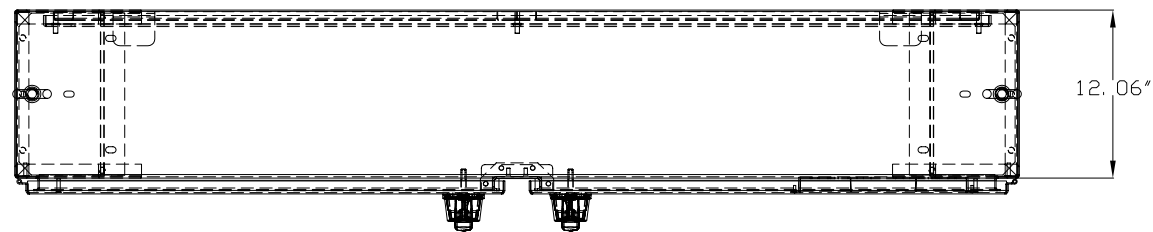


FRONT PANEL VIEW

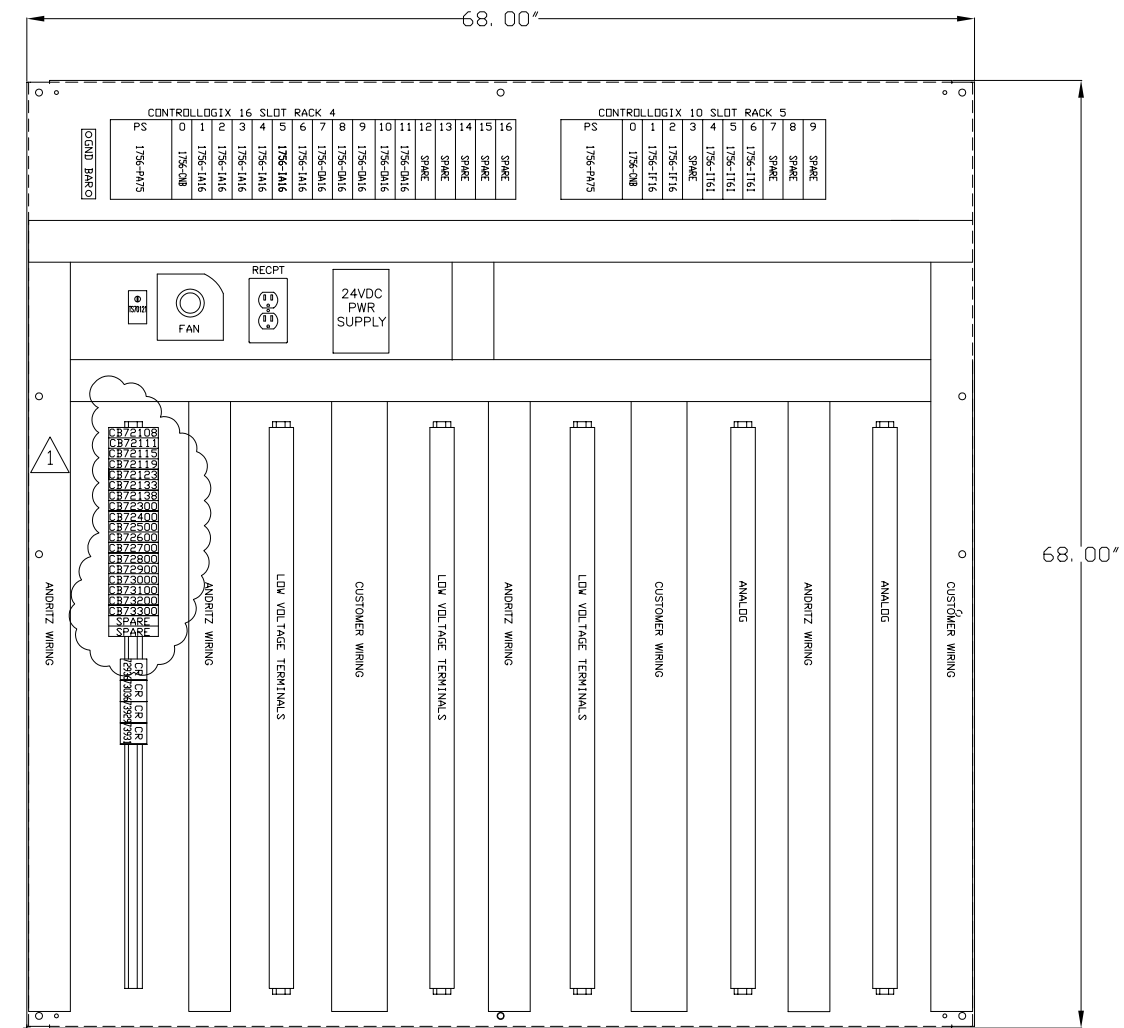


BOTTOM VIEW

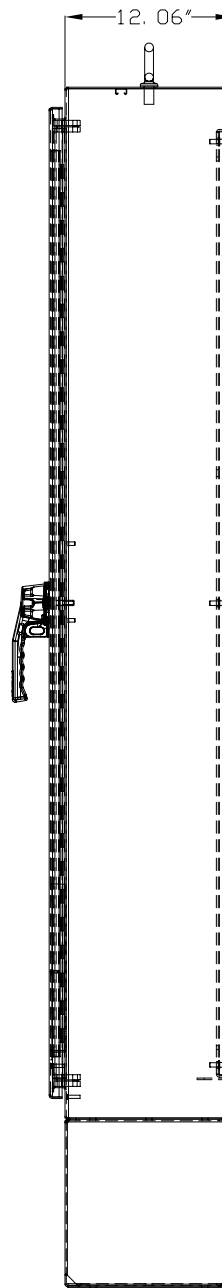

PANEL VIEW

NOTES:


- 1) ENCLOSURE IS NEMA 4X 316 STAINLESS STEEL. PANEL DEPTH IS 12". (HOFFMAN ENCLOSURE OR EQUIVALENT A72HX7312SSLPT)
- 2) CONTROL RELAYS ARE 120 VOLT COILS WITH CONTACT RATED FOR 10 AMPS@ 120VAC.
- 3) ALL WIRING TO CONFORM TO NATIONAL ELECTRIC CODE AND INCLUDES PERMANENT WIRE MARKERS.
- 4) ENCLOSURE LIGHT TO HAVE DOOR SWITCH.
- 5) INDICATOR LIGHTS TO 120V LED TYPE.
- 6) PANELS TO BE UL-508 LISTED



DATE:	3/1/06	
DRAWN BY:	BB	
CHECKED BY:		
APPROVED BY:		
SCALE:	NONE	
FILE:	1524E1402	
SIZE:		
REV	DESCRIPTION	DATE
0	ADDED CR, DEL BREAKERS, UPDATE CONTROL LAYOUT (EIR16)	10/13/06
1	FOR FINAL REVIEW/BUILDING PERMIT	06/05/06
D	REMOVAL OF TRUCK LOADOUT CNTRL 3 & 4 (EIR16)	05/11/06

JOB NAME: CITY OF STAMFORD CONNECTICUT SOLIDS DRYING PROJECT  
 TITLE: TRUCK LOADOUT PANEL (R10-50) WIRING DIAGRAM  
 PROJECT NUMBER: 1524  
 DRAWING NUMBER: EI-402  
 SHEET 1 OF 1

RELEASED 12/08/06  
 REVISION - 1



THIS DRAWING IS A TRADE SECRET AND ONLY ENTRUSTED TO THE RECEIVER FOR HIS PERSONAL USE. WITHOUT THE SIGNED WRITTEN CONSENT OF ANDRITZ-RUTHNER, INC., IT MUST NOT BE COPIED NOR MADE AVAILABLE TO THIRD PARTIES, INCLUDING COMPETITORS, NOR MADE ACCESSIBLE TO SUCH PARTIES. ANY ILLEGAL USE BY THE RECEIVER OR THIRD PARTIES FOR WHICH HE IS RESPONSIBLE CAN CONSTITUTE A CAUSE FOR LEGAL ACTION. THIS DRAWING MUST BE RETURNED ON REQUEST OF THE COMPANY.