



1 2 3 4 5 6
FIELD REMOTE I/O MCC BUCKET PANEL

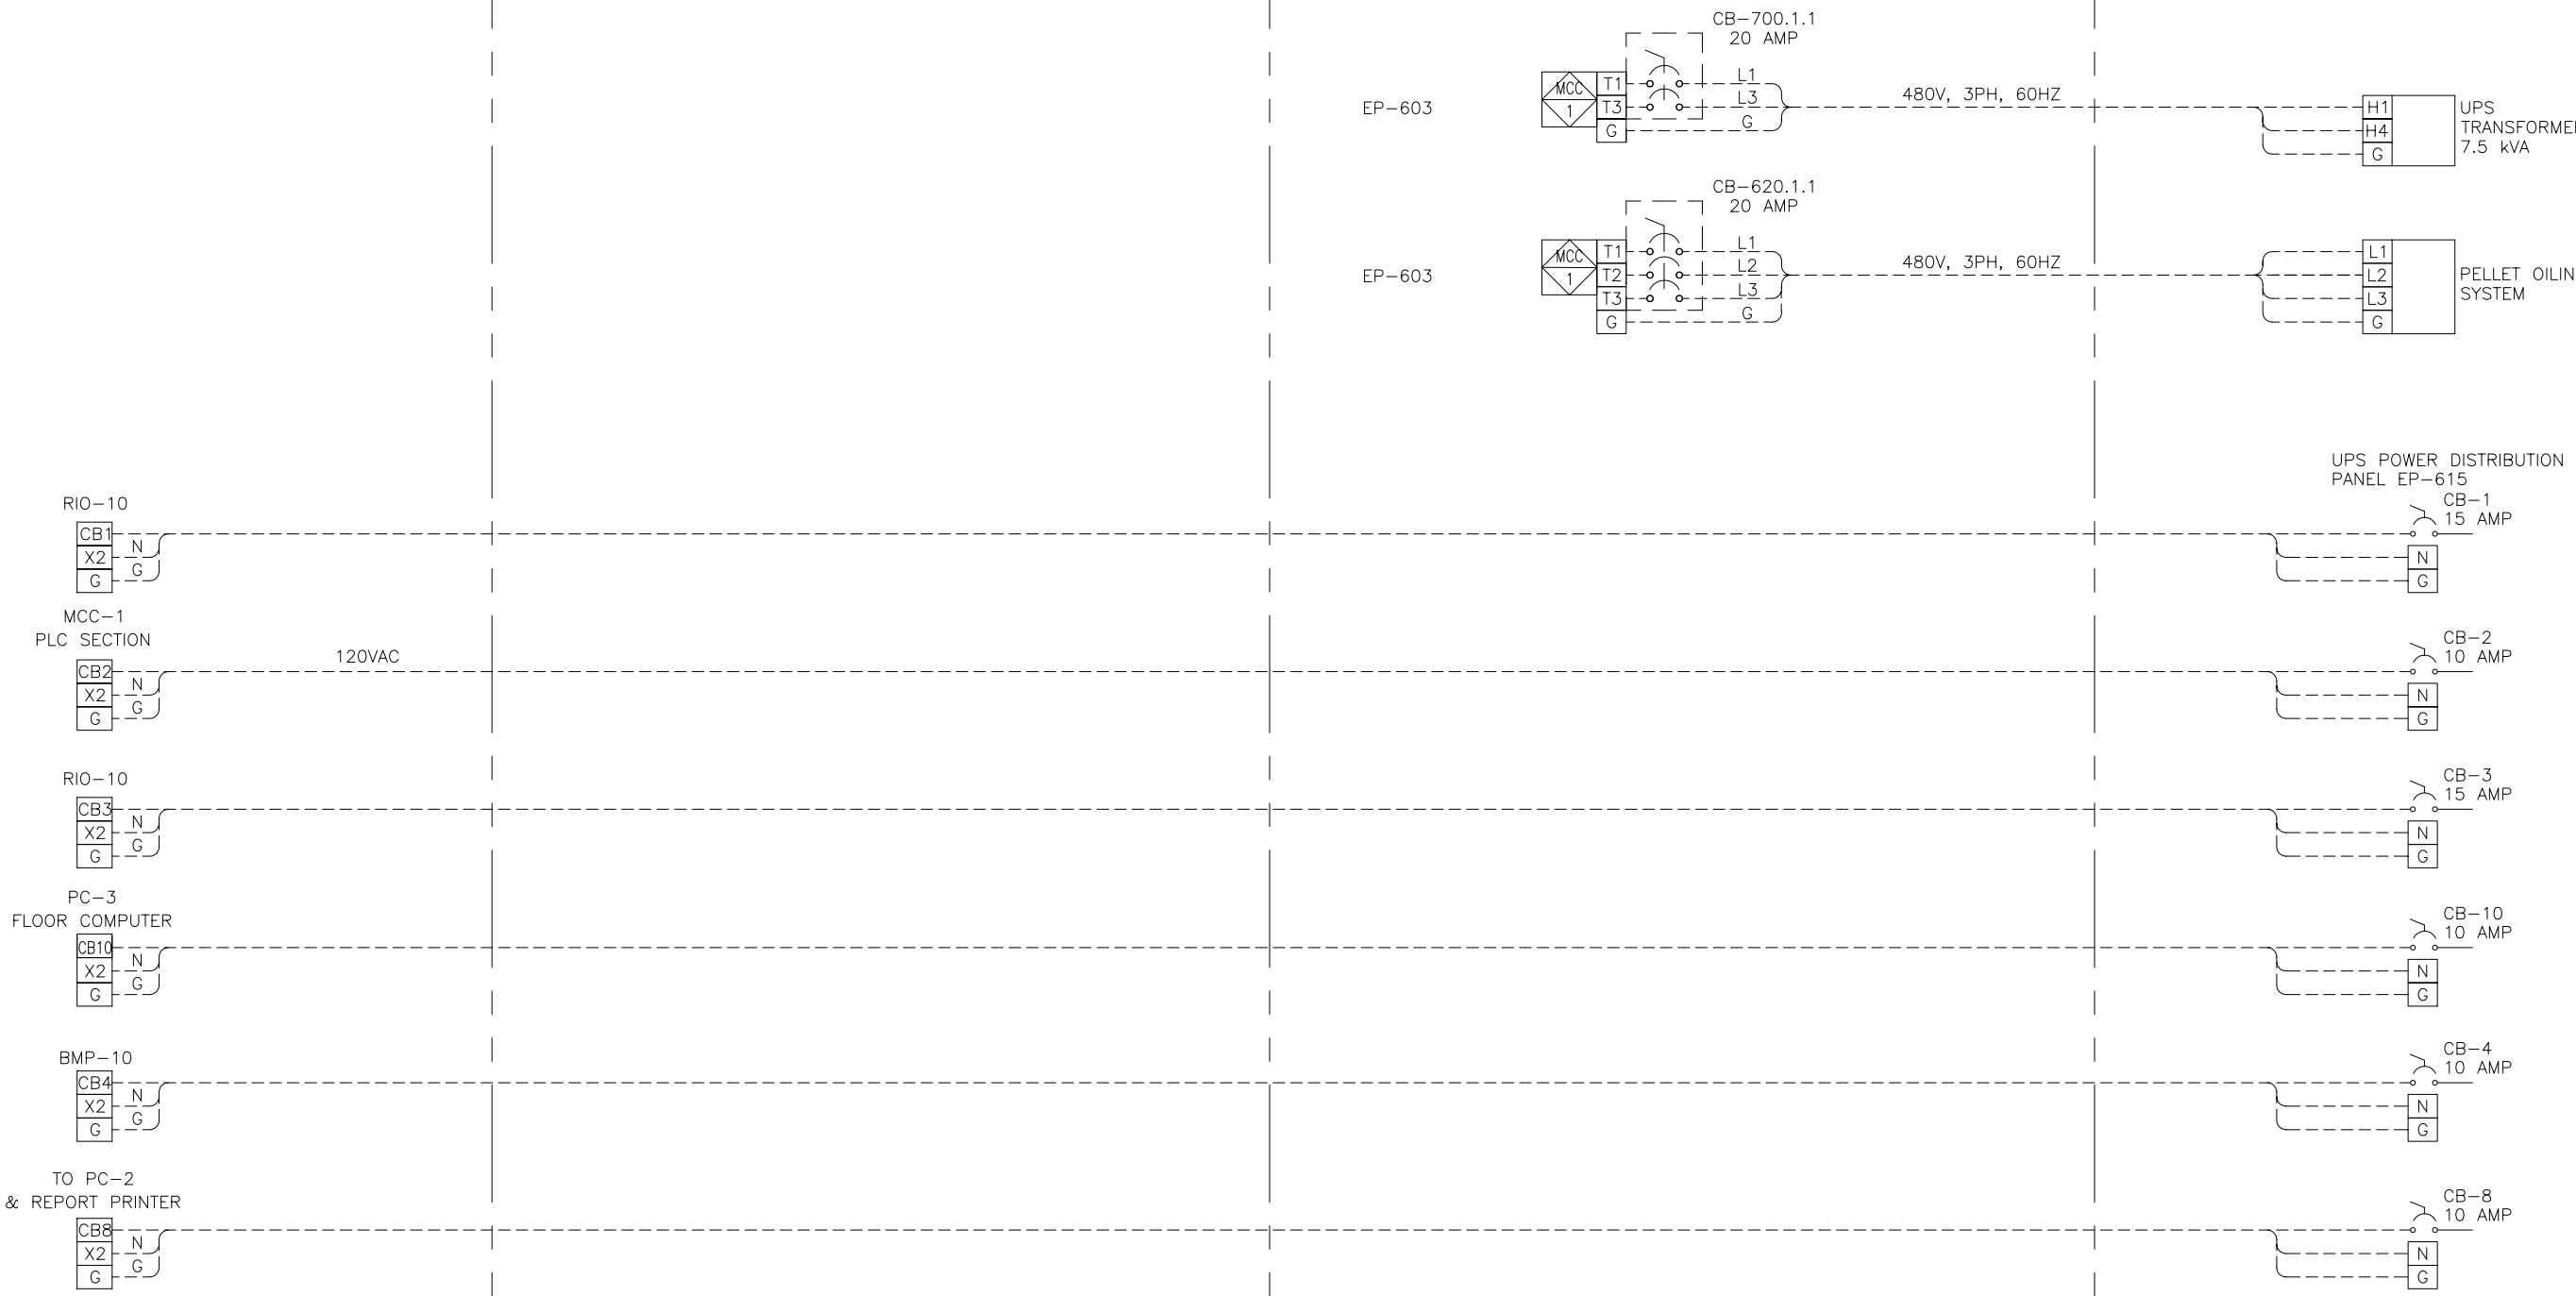

TAG	DESCRIPTION	MANUFACTURER	MODEL NO.	CALIBRATION
CB-700.1.1	CIRCUIT BREAKER UPS PANEL	X	X	X
CB-620.1.1	CIRCUIT BREAKER PELLET OIL	X	X	X

ANDRITZ
ANDRITZ-RUTHNER, INC.
1010 COMMERCIAL BLVD. SOUTH
ARLINGTON, TEXAS 76001
(817) 485-5611



DATE	REVISION
12/08/06	0 FOR FINAL REVIEW/BUILDING PERMIT

DATE: 3/27/06	FILE: 1524E1870	PROJECT NUMBER: 1524	TITLE: PELLETTIZING TRAIN GROUP 700 LOOP DIAGRAM
DRAWN BY: BB	SCALE: NONE	REV: 0	
CHECKED BY:	SIZE:	REV: 0	
APPROVED BY:		REV: 0	

JOB NAME: CITY OF STAMFORD CONNECTICUT SOLIDS DRYING PROJECT
TITLE: PELLETTIZING TRAIN GROUP 700 LOOP DIAGRAM
PROJECT NUMBER: 1524
DRAWING NUMBER: EI-870
SHEET 1 OF 2
DATE: 12/08/06

